



GERMAN-based company ●●●

SOLAR PANEL INSTALLATION MANUAL





HEADQUARTER

Angerlweg 14
85748 Garching
Munich/Germany

Phone: +49 89 1250 36 860

Home: www.tommatech.de

E-mail: mail@tommatech.de

CONTENTS

1.	INTRODUCTION.....	4
2.	CODES AND REGULATIONS	4
3.	GENERAL	4
3.1	Product Identification	5
3.2	General Safety	5
3.3	Electrical Performance Safety	5
3.4	Operating Safety.....	6
3.5	Fire Safety	6
4.	INSTALLATION CONDITION.....	7
4.1	Installation Position and Working Environment.....	7
4.2	Tilt Angle Selection.....	7
5.	MECHANICAL INSTALLATION	8
5.1	Conventional Requirement.....	8
5.2	Installation Method.....	9
5.2.1	Solar panels installed with mounting holes	9
5.2.2	Solar panels Installed with clamp.....	9
5.2.3	Description of the installation position.....	11
6.	ELECTRICAL INSTALLATION	12
6.1	Electrical Property.....	12
6.2	Cables and Wiring.....	13
6.3	Connectors	13
6.4	Bypass Diodes.....	14
7.	GROUNDING.....	14
7.1	Grounding by Using Grounded Clamp.....	14
7.2	Grounding by Using Unused Mounting Hole.....	15
7.3	Additional Third-Party Grounding Devices.....	16
8.	OPERATION AND MAINTENANCE	17
8.1	Cleaning	17
8.2	Visual Inspection of Solar panels	17
8.3	Inspection of connector and cable	17
9.	APPLICABLE PRODUCTS.....	19

1. INTRODUCTION

TommaTech GmbH (hereafter referred to as “TommaTech”) headquarters in Garching / Germany engages in the development, research, manufacturing, sales and service of solar panels, inverters and their required accessories.

TommaTech established strong and competitive partnerships in the photovoltaic field in Europe and in Far East with companies that value quality and reliable solar power generation. We will support you with our strong and experienced team for the purchase of solar equipment as well as turnkey projects with a wide product range and variety of methods and procedures. Our mission is to make human life more sustainable, making the difference in the industry through unique customer focus and high quality, thus progressing confidently towards becoming a world leader in our own sector.

2. CODES AND REGULATIONS

The mechanical and electrical installation of PV systems should be performed in accordance with all applicable codes, including electrical and construction codes as well as electric utility connection guidelines.

Such requirements may vary with the mounting location, such as building rooftop or motor vehicles as well as with the system voltages, and for DC or AC capacity applications. Please contact your local authorities for the corresponding governing regulations in place.

3. GENERAL

The parts of our solar panels are indicated in the cross-section figure below:

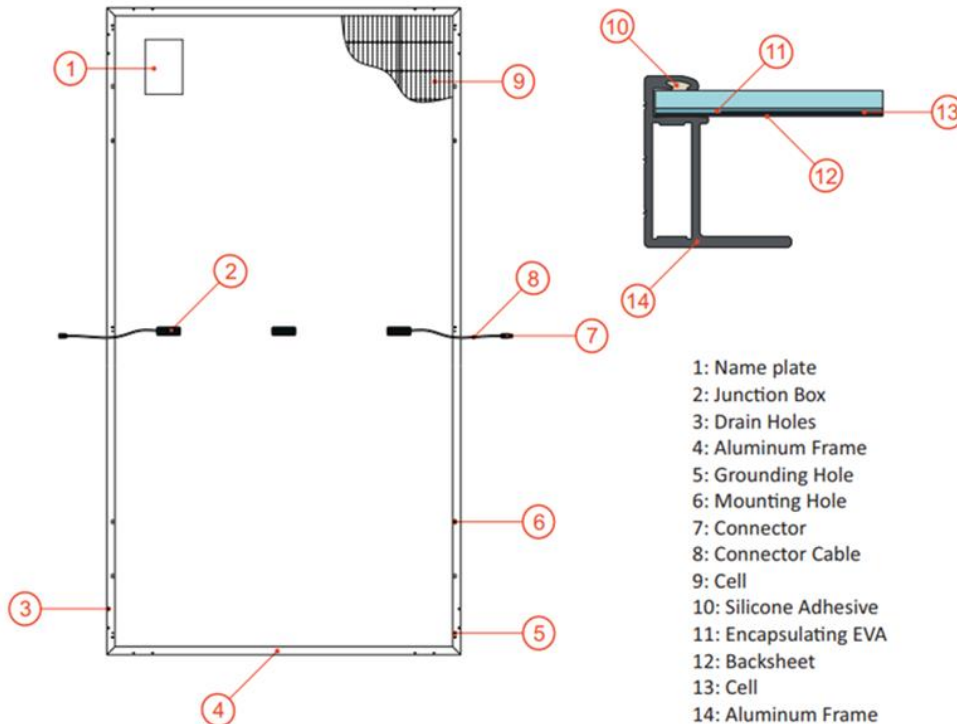


Figure 1: Modules components and cross-section of the laminated assembly

3.1 Product Identification

Each module has three labels providing the following information:

1. Nameplate. The name plate describes the product type, peak power, max. power point current, max. power point voltage, open circuit voltage, short circuit current, as measured under standard test conditions, certification marks, the maximum system voltage etc.
2. Current Classes. Solar panels are divided into three classes according to the maximum power current: 1, 2 or 3 (3 means the highest current). This class is marked as a number on the pallets of the solar panels. To achieve an optimal performance of the solar panels, it is recommended to only connect solar panels with the same current class in a string.
3. Barcode: Each individual module has a unique serial number. The serial number has 12 digits. From 1st to 2nd digits are the solar cell size code, and the 3rd and 4th are the corrected year code, from 5th and 6th are the corrected month codes, from 7th is the optional serial number and from 8th and 12th are the serial number of a module. For example, 133414000001 means the Module was assembled and tested in the January of 2021. It is permanently attached to the interior of the modules and is visible from the top front of the Module. This barcode is inserted prior to laminating. In addition, you can find a same barcode beside the nameplate and two sides of frame surfaces.

3.2 Conventional Safety

TommaTech modules are designed to meet the requirements of IEC 61215 and IEC 61730, PV module classification: Class II

Modules rated for use in this PV module classification may be used in system operating at greater than 50V DC or 240W, where general contact access is anticipated. Modules qualified for safety through IEC 61730-1 and IEC 61730-2 and within this PV module classification are considered to meet the requirements for safety class II equipment.

When modules are mounted on rooftops, the roof must have a fire-resistant covering suitable for this application. Rooftop PV systems should only be installed on rooftop that can handle the additional weighted load of PV system components, including Modules, by a certified building specialist or engineer and have a formal structure of the complete analysis result.

For your safety, do not attempt to work on a rooftop until safety precautions have been identified and taken including without limitation fall protection measures, ladders or stairways, and personal protective equipment.

For your safety, do not install or handle Modules under adverse conditions, including without limitation strong or gusty winds, and wet or frosted roof surfaces.

3.3 Electrical Performance Safety

Photovoltaic Modules can produce DC electricity when exposed to light and therefore can produce an electrical shock or burn. DC voltage of 30 Volts or higher is potentially lethal.

Modules produce voltage even when not connected to an electrical circuit or load. Please use insulated tools and rubber gloves when working with Modules in sunlight.

Modules have no on/off switch. Modules can be rendered inoperative only by removing them from sunlight, or by fully covering their front surface with cloth, cardboard, or other completely opaque material, or by working with Modules face down on a smooth, flat surface.

In order to avoid arcs and electrical shock, please do not disconnect electrical connections under load. Faulty connections can also result in arcs and electrical shock. So please keep connectors dry and clean, and ensure that they are in proper working condition. Never insert metal objects into the connector or modify them in any way to secure an electrical connection.

Also, to avoid the sand or water vapor entering which may cause the connection and safety issue, the modules need to be installed and connected to the combiner box once they are taken out from the carton box; keep the connectors dry and clean during the installing. Note that the pollution from sand, dust and water will result in arcs and electrical shock of connectors.

Reflection from snow or water can increase sunlight and therefore boost current and power. In addition, colder temperatures can substantially increase voltage and power.

If the glass or other material is damaged, please wear personal protection equipment and separated the Modules from the circuit.

Work only under dry conditions and use only dry tools. Do not handle Modules when they are wet unless wearing appropriate protective equipment. If you need to clean the Modules, please follow the cleaning requirements mentioned in the manual.

3.4 Operating Safety

Do not open packages of TommaTech solar panels during transportation and storing until they are ready to be installed.

At the same time please protect the package from damages. Do not make the pallets of solar panels fall over directly.

Do not exceed the maximum height of pallets to be stacked as indicated on the pallet packaging. Store pallets in a ventilated, rain-proof, and dry location until the solar panels are ready to be unpacked. Do not lift the solar panels by grasping the module's junction box or electrical cable under any condition.

Do not stand or step on the solar panels.

Do not drop the solar panels on other solar panels.

Do not place any heavy objects on the solar panels.

Be cautious when setting the solar panels down on a surface, especially on the corner of the solar panels. Inappropriate transportation and installation may break the solar panels.

Do not attempt to disassemble the solar panels, and do not remove any attached nameplates or components from the solar panels.

Do not apply paint or adhesive to the solar panels top surface.

To avoid damage to the backsheet, do not scratch or hit the backsheet.

Do not drill holes in the frame. This may compromise the frame strength and cause corrosion of the frame.

Do not scratch the anodized coating of the frame (except for grounding connection). It may cause corrosion of the frame or compromise the frame strength.

Do not attempt to repair the solar panels with damaged glass or backsheet.

3.5 Fire Safety

Consult your local authority for guidelines and requirements for building or structural fire safety. TommaTech modules have been listed as Class C according to IEC 61730-2 standard. For roof installations, Modules should be mounted over a fire-resistant covering suitable for this application, with adequate ventilation between the Modules backsheet and the mounting surface. Roof constructions and installations may affect the fire safety of building. Improper installation may create hazards in the event of a fire.

Consult your local authority for guidelines and requirements for building or structural fire safety. TommaTech modules are listed as Class C according to the IEC 61730-2 standard.

For roof installations, Solar panels should be mounted over a fire-resistant covering suitable for this application, with adequate ventilation between the modules backsheet and the mounting surface. Roof constructions and installations may affect the fire safety of building. Improper installation may create hazards in the event of a fire.

Solar panels should not be installed on structures and products made of transparent plastic, plastic and similar materials that are resistant to fire risk and not protected.

In order to maintain the fire class rating, the distance between the modules frame surface and the roof surface shall be at least 8 cm.

Regulations, communiqués, decrees, specifications, etc., put into effect by the relevant official institutions and organizations in the region where the installation will take place. Appropriate components such as fuses, circuit breakers, surge arresters and grounding connectors must be used to meet the requirements specified in all legislation. Any string or optimizer connector to be connected with the solar panel connector must be the same brand and model as the connector on the solar panel.

Do not install solar panels in places where flammable-explosive chemical products, gases and similar products can be found.

Panels that have not been installed in accordance with these standards and conditions will be out of warranty, the installation will be installed contrary to the installation manual, and the manufacturer will not be responsible for any risks or problems that may occur. In this context, the manufacturer does not have any responsibility, including compensation for damages, for any use contrary to the installation and assembly manual and for the consequences of such use.

4. INSTALLATION CONDITIONS

4.1 Installation Position and Working/Operational Environment

TommaTech solar panels are intended for use in terrestrial applications and only for outside installation.

Do not use mirrors or other magnifiers to concentrate sunlight onto the solar panels.

Solar panels must be mounted on appropriate mounting structures positioned on suitable buildings, the ground, or other structures suitable for solar panels (e.g., carports, building facades or PV trackers).

Solar panels must not be installed in locations where they could be submerged in water.

The temperature limits are defined as the monthly average high and low of the installation site. The limit operating temperature should be -40°C (-40°F) and 85°C (185°F).

Ensure that the solar panels are not subject to wind or snow loads exceeding the maximum permissible loads. The solar panels should be installed in a location where there is no shading throughout the year.

Ensure there is no obstacle to block light near the installation site.

Lightning protection is recommended for PV systems that are to be installed in locations with high probability of lightning strikes.

Do not use solar panels near equipment or in locations where flammable gasses may be generated or collected.

The solar panels can be installed at a maximum 2000m altitude.

TommaTech solar panels must neither be installed nor operated in areas where hail, snow, sand, dust, air pollution, soot, etc., are excessive. Solar panels must not be sited in locations where aggressive substances such as salt, salt mist, saltwater, chemically active vapors, acid rain or, any other type of corrosive agent could affect the safety and/ or performance of the solar panels.

Please implement appropriate measures to ensure the performance and safety of the solar panels when they are installed or operated in the areas with heavy snow, extremely cold climates, strong winds, on islands or in a desert where the solar panels are prone to produce salt fog, or near water.

4.2 Tilt Angle Selection

The tilt angle of the solar panels is measured between the surface of the solar panels and a horizontal ground surface. The solar panels generate maximum power output when facing the sun directly.

In the northern hemisphere, solar panels should typically face south, while in the southern hemisphere, solar panels should typically face north.

For detailed information on the best installation angle, please refer to standard solar photovoltaic installation guides or consult a reputable (local) solar installer or systems integrator.

Dust building up on the surface of the solar panels can impair with the solar panels' performance.

TommaTech recommends installing the solar panels with a tilt angle of at least 10 degrees, making it easier for dust to be washed off by rain.

5. MECHANICAL INSTALLATION

5.1 General Requirements

Please ensure that the installation method and support structure of solar panels is strong enough to enable the solar panels to withstand all load conditions, which must be guaranteed by the installer. The installation support structure must be tested by a third-party organization with static mechanical analysis ability, according to the local national or international standards such as DIN1055 or equivalent.

The solar panels mounting structure must be made of durable, corrosion-resistant, and UV-resistant materials.

Solar panels must be securely attached to the mounting structure.

In regions with heavy snowfall, select the height of the mounting system, so that the lowest edge of the solar panels is not covered by snow for any period of time. In addition, ensure that the lowest portion of the solar panels is placed high enough so that it is not shaded by plants or trees or damaged by flying sand.

When the solar panels are installed parallel to the surface of the building wall or roof, a minimum clearance of 10 cm between the solar panels frame and the surface of the wall or the roof is required to allow air circulation behind the solar panels and to prevent wiring damages.

Do not attempt to drill holes in the glass surface or frames of the solar panels.

Before installing solar panels on a roof, ensure that the roof construction is suitable. In addition, any roof penetration required to mount the solar panels must be properly sealed to prevent leaks.

To observe the linear thermal expansion of the module frames, you must ensure a minimum distance between neighboring frames of 10 cm.

Always keep the backsheet of the panel free from foreign objects or mounting elements, which could come into contact with the panel, especially when the panel is under mechanical load.

TommaTech solar panels have been certified for a maximum static load on the back-side of 2400 Pa (i.e. wind load) and a maximum static load on the front side of 2400 Pa (i.e. wind and snow load), depending on the solar panels type (please refer to Figure 4 for detailed installation method). These load values are maximum. The design load for 2400 Pa is 1600 Pa with a safety factor is 1.5.

The mounting method must not result in the direct contact of dissimilar metals with the aluminum frame of the solar panels that will result in galvanic corrosion.

TommaTech solar panels can be mounted in landscape or portrait orientation.

5.2 Installation Method

TommaTech solar panels can be installed using the mounting holes in the frame, clamps, or an insertion system. Solar panels must be installed according to the following examples and recommendations. If you cannot mount the solar panels according to these instructions, please consult TommaTech in advance since the alternative mounting method must be approved by TommaTech, otherwise it may damage solar panels, and void the warranty.

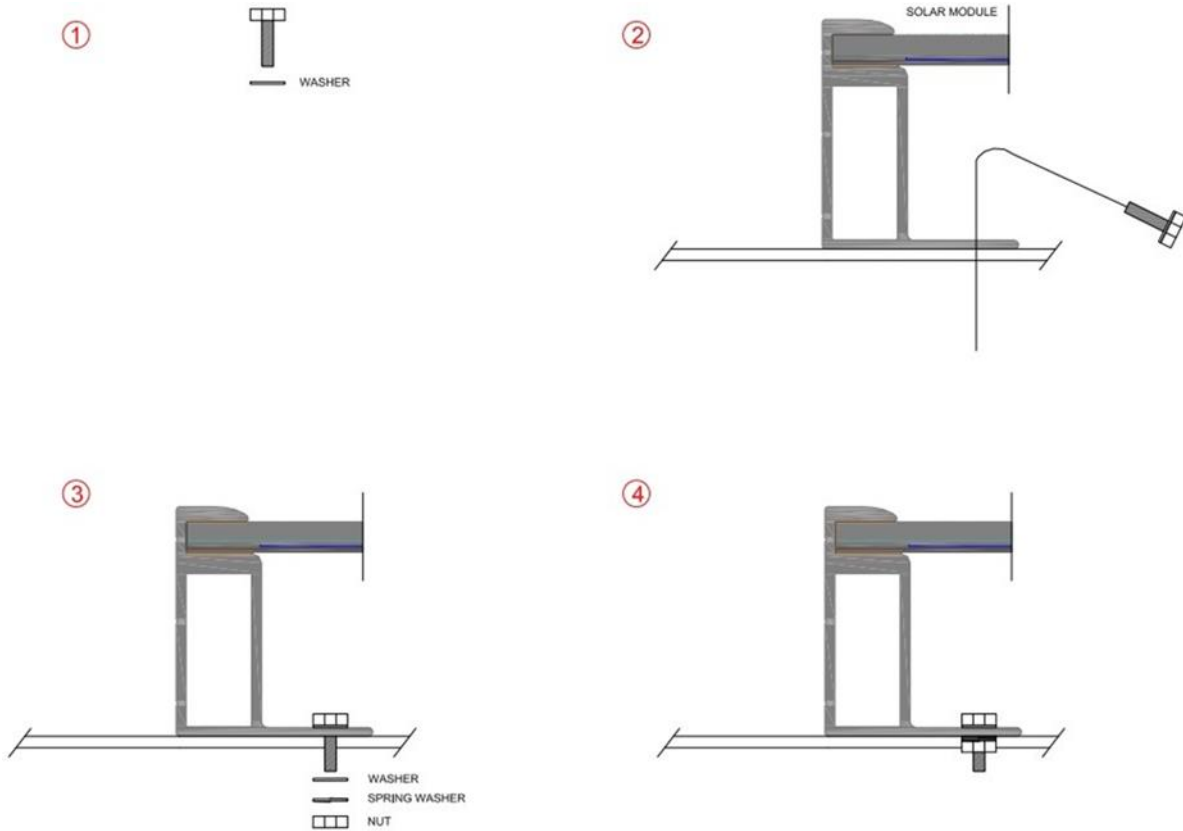


Figure 2: Mounting Details

5.2.1 Modules installed with mounting holes

Modules should be bolted to support structures through mounting holes located in the frame's back flanges. Refer to what is shown in Figure 2 (Mounting Details).

5.2.2 Solar panels Installed with clamps

Modules should be mounted using specialized clamps as shown in Figure 3.

A) Modules should be attached on a supporting structure rail by metal clamps. It is recommended to use the clamps under the following condition or approved by system installation

- Width: Clamp A no less than 38mm, Clamp B no less than 50mm,
- Thickness: No less than 3mm
- Material: Aluminum Alloy
- Bolt: M8

B) Bolt torque requirement: 12-16 Nm

C) The module clamps must not contact the front glass or deform the frame in any way, the contact area of the clamp with the front of the frame must be smooth, otherwise it might damage the frame or result in broken solar panels. Avoid shading effects through the module clamps. Drainage holes on the solar panels frame must not be closed or obscured.

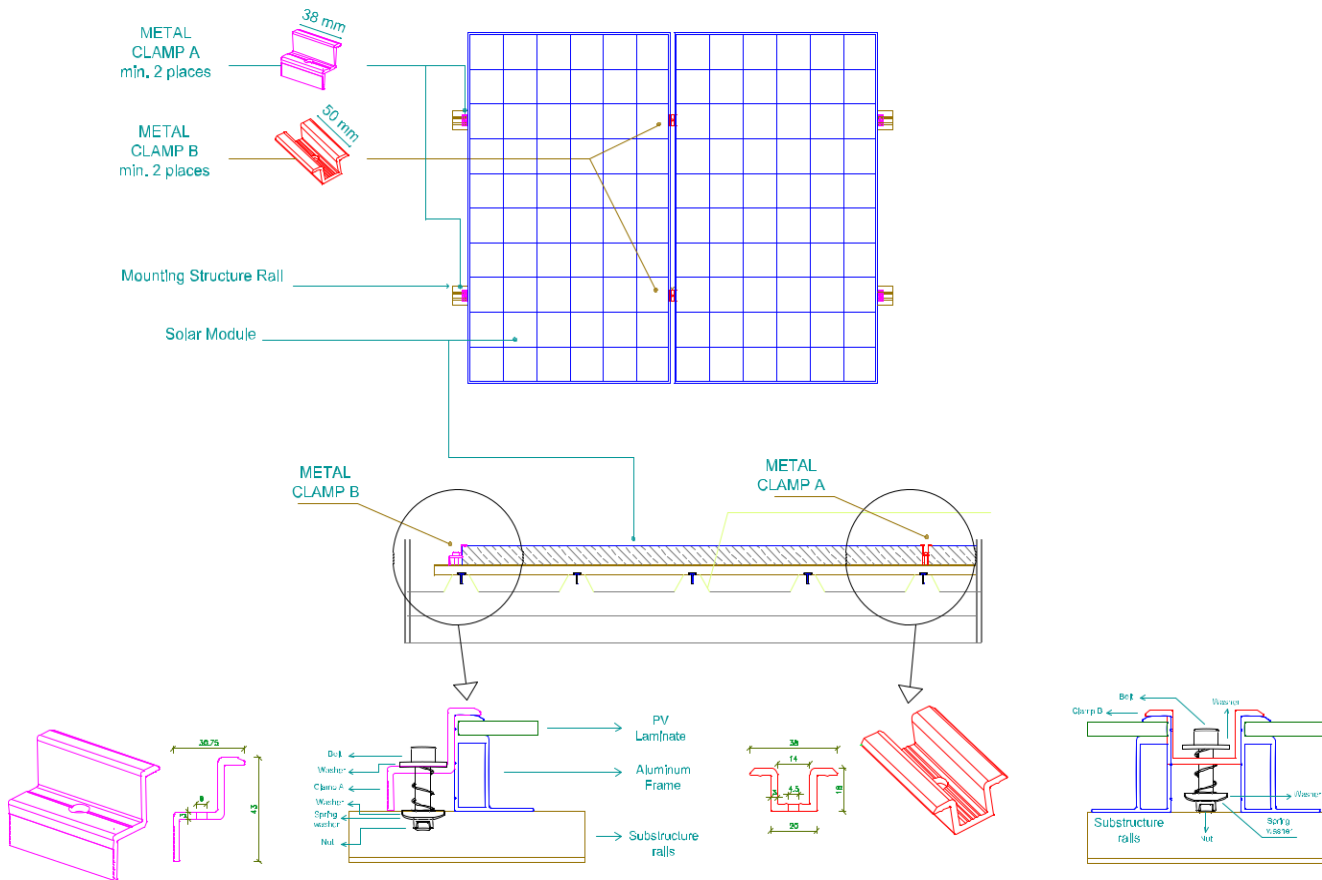


Figure 3: Clamp Details (Units: mm)

5.3 Description of the installation position

The low/normal level of load condition is applicable to the installation in most of environmental conditions: the maximum static test load on the back of the Modules is 2400 Pa (i.e., wind load), and the maximum static test load on the front of the Modules is 2400 Pa (i.e., wind and snow load).

The high level of load condition is applicable to the installation in harsher environmental conditions such as storm, heavy snow, etc. the maximum static test load on the back of the Modules is 2400 Pa (i.e., wind load) and the maximum static test load on the front of the Modules is 2400 Pa (i.e., wind and snow load), depending on the pressure level that it would endure according to IEC standard.

For the dynamic loads, such as wind, the safety factor needs to be increased by 3 times. It means that the maximum dynamic load is 800 Pa when the wind speed is less than 130 km/h.

The mechanical load tests carried out within the certification were made in the form of a red marked assembly. It must be installed in this way for warranty coverage.

(Design load: 1600 Pa for wind load, 2400 Pa for snow load, safety factor $\gamma_m = 1.5$)

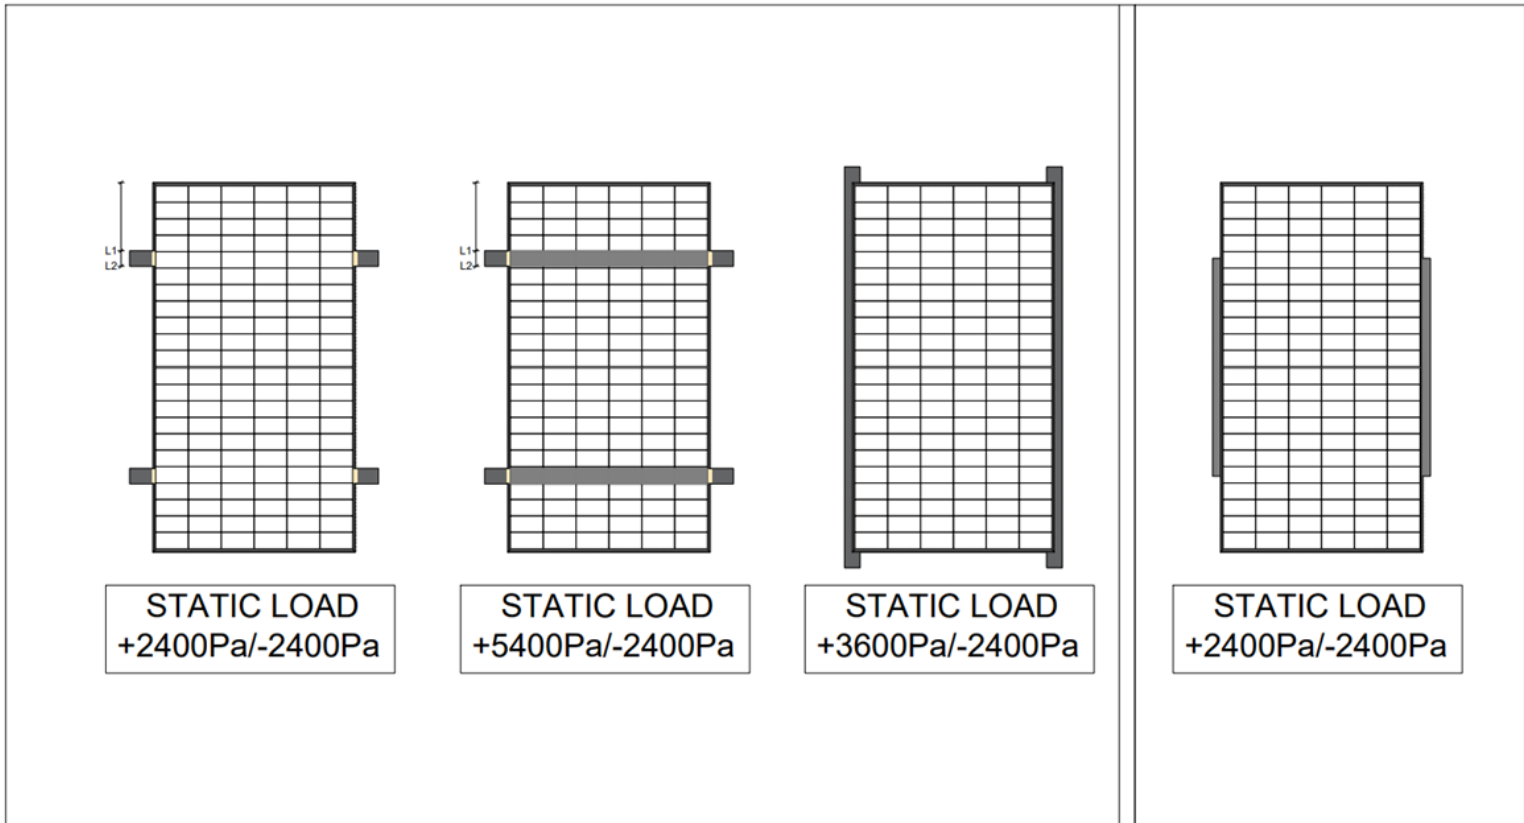


Figure 4: Installation Methods

The L_1 and L_2 values in Figure 4, represent the mounting distance depending on the model type. In the "9. APPLICABLE PRODUCTS" section, the values are shown in the table.

6. ELECTRICAL INSTALLATION

6.1 Electrical Characteristics

Rated electrical characteristics such as I_{sc} , V_{oc} and P_{max} are measured within $\pm 3\%$ of measurement uncertainty at standard test condition (STC): $1000\text{W}/\text{m}^2$ irradiance, 25°C Cell Temperature and 1.5 Air Mass.

Under normal conditions, photovoltaic solar panels may produce higher currents and/or voltages than reported at Standard Test Conditions. Accordingly, the values of short circuit current, I_{sc} , and open circuit voltage, V_{oc} , marked on solar panels should be multiplied by a factor of 1.25 when determining component voltage ratings, conductor capacities, fusing sizes, and size of controllers connected to the solar panels.

Voltages are additive when solar panels are connected in series, while the currents are additive when they are connected in parallel, as illustrated in Figure 5 on the next page.

The number of panels which can be connected to a string is calculated according to the voltage of the junction box of the panels, the NOCT value of the panel, the DC input voltage of the inverter to be used and the ambient temperature of the location of the plant. Solar panels with different electrical characteristics must not be connected directly in series.

$$\text{System Voltage} \geq N * V_{oc} [1 + TC_{Voc} * (T_{min} - 25)]$$

N = Number of panels in the series

V_{oc} = Open Circuit Voltage (data on product label or datasheet)

TC_{Voc} = Temperature coefficient of open circuit voltage (data on product label or datasheet)

T_{min} = Minimum ambient temperature

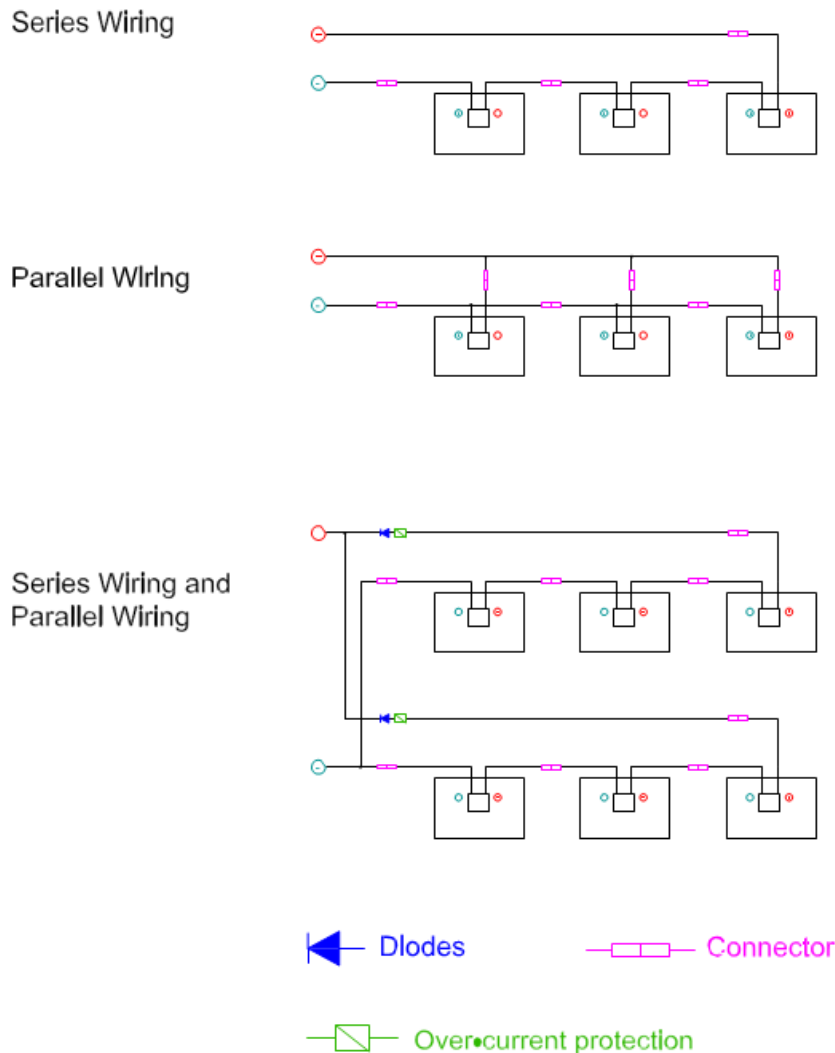


Figure 5: Electrical Diagrams of Series and Parallel Connection

Please note that the maximum number of solar panels which can be connected in a series string must be calculated in accordance with applicable regulations in such a way that the specified maximum system of the solar panels and all other electrical DC components will not be exceeded in open-circuit operation at the lowest temperature expected at the PV system location (The maximum system voltage of TommaTech solar panels is 1000VDC/ 1500VDC according to the safety standards of IEC61730). An appropriately rated over-current protection device must be used when the reverse current could exceed the value of the maximum fuse rating of the solar panels. An over-current protection device is required for each string if more than two strings are connected in parallel, as illustrated in Figure 5 above.

6.2 Cables and Wiring

Please note that the junction boxes at the back of the solar panels have been designed to enable easy and reliable connection in series with IP67 protection grade. Each module has two single-conductor wires, one positive and one negative, which are pre-wired inside the junction box. The connectors at the opposite end of these wires allow easy series connection of adjacent solar panels by firmly inserting the positive connector of a module into the negative connector of an adjacent module until the connector is fully seated.

For field wiring please use cables with suitable cross-sectional areas that are approved for operation at the maximum short-circuit current of the solar panels. TommaTech recommends to only use UV resistant cables which are qualified for direct current (DC) wiring in PV systems. The minimum wire size should be 4mm². For example, a solar cable according to the specifications is recommended.

Testing Standard	Wire size	Temperature Rating
TÜV 2 PFG 11694	4mm ²	-40°C to +90°C

The cable of the junction box is identified as L1 as shown in Figure 6 below. L1 for TommaTech standard module is 1000/1200 mm, L1 for half-cut module is 300/1200 mm and L1 for bifacial module is 300/1200 mm. L1 for special modules may vary depending on the situation. Please consider the cable length before designing the wiring layout.

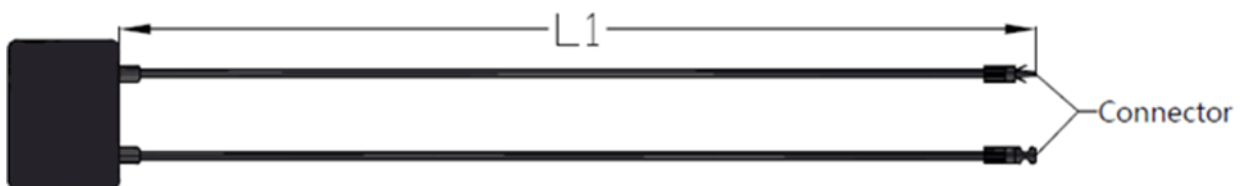


Figure 6: Junction Box Cable

Cables should be fixed to the mounting structure in such a way that mechanical damage of the cable and/or the Modules is avoided. Do not apply stress to the cables. For fixing, use appropriate means, such as sunlight resistant cable ties and/or wire management clips specifically designed to attach to the Modules frame. While the cables are sunlight resistant and waterproof, where possible, avoid direct sunlight exposure and water immersion of the cables.

6.3 Connectors

Keep connectors dry and clean. Do not attempt to make an electrical connection with wet, soiled, or otherwise faulty connectors. Avoid sunlight exposure and water immersion of the connectors. Avoid allowing connectors to rest on the ground.

Faulty connections can result in arcs and electrical shocks. Please ensure that all electrical connections are securely fastened and that all locking connectors are fully engaged and locked. The connectors can only be unlocked with the tool PV-MS-PLS. Only the same type of connectors can be used for installation.

6.4 By-Pass Diodes

The junction boxes installed at the back of TommaTech solar panels contain by-pass diodes wired in parallel with the PV cell strings. In the case of partial shading, the diodes bypass the current generated by the nonshaded cells, thereby limiting solar panels heating and performance losses.

By-pass diodes are not over-current protection devices but divert current from the cell strings in the event of partial shading.

In the event of a known or suspected diode failure, installers or maintenance providers should contact TommaTech. Never attempt to open the junction box by yourself.

7. GROUNDING

TommaTech solar panels are manufactured with an anodic oxidized aluminum frame to resist corrosion. Consequently, the frame of the solar panels must be connected to the equipment grounding conductor to prevent thunder and static damage.

The grounding device must fully contact with the inside of the aluminum alloy and must penetrate the surface of the frame oxidation film.

Please do not drill any additional grounding hole on the frame of the solar panels. The frame rails have pre-drilled holes marked with a grounding sign. These holes should be used for grounding purposes and must not be used for mounting the solar panels.

For optimal performance, TommaTech recommend the DC cathode of the solar panels arrays to be connected to ground. Failure to comply with this requirement may reduce the performance of the system.

The grounding method must not result in direct contact of dissimilar metals with the aluminum frame of the solar panels that will result in galvanic corrosion.

The following grounding methods are available.

7.1 Grounding by Using Grounding Clamps

There is a bonding hole with 4.2 mm diameter on the edge side closer to the middle of the back frame of the Modules. The middle line of the bonding mark is overlapped with the bonding hole, and the direction is same as the longer frame.

The bonding between Modules must be approved by qualified electrician. And the bonding device must be produced by qualified electrical manufacture. The recommended twist torque value is 2.3 N.m. A copper core in size of 12 AWG can be used as bonding clamp. The copper wire should not be compressed during the installation.

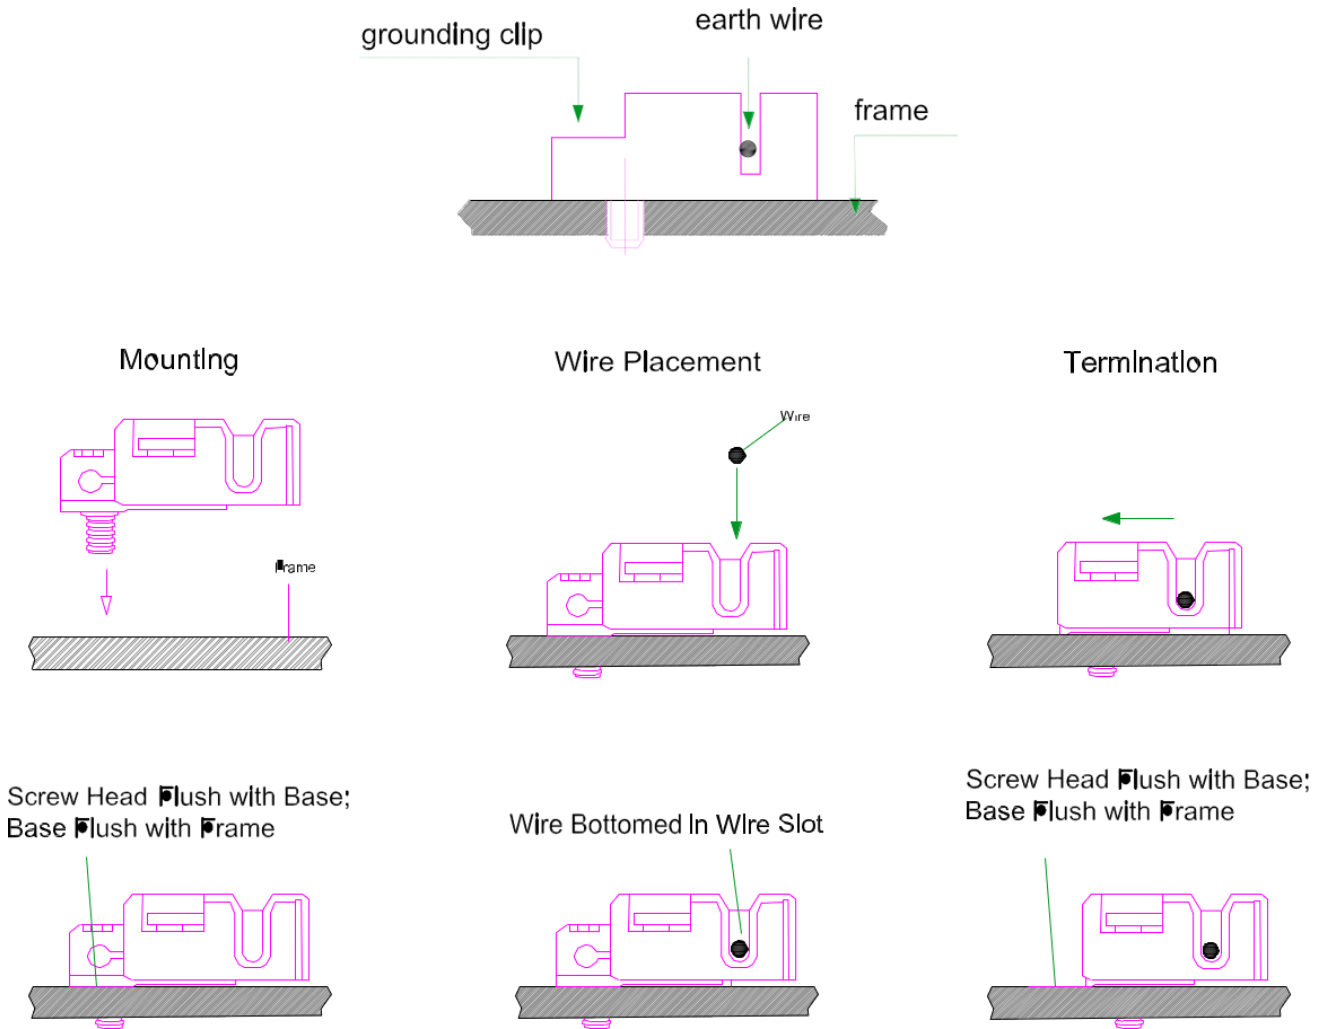


Figure 7: Grounding Wire Installation Methods

7.2 Grounding by Using Unused Mounting Holes

The existing Mounting holes which have not been used can be used for bonding.

- A) Direct the bonding clamp to the mounting hole on the frame. Thread the bonding clamp and the frame with bonding bolt.
- B) Put the toothed gasket into the other side, than tighten and lock the nut. The recommended torque of locking the nut is 2.0 Nm-2.2 Nm.
- C) Thread the bonding clamp with bonding wire. The material and size of bonding wire should meet the relevant requirements of the national, regional, and local rule, law, and standard.
- D) Finish the mounting with tightening the binding bolt of the bonding wire

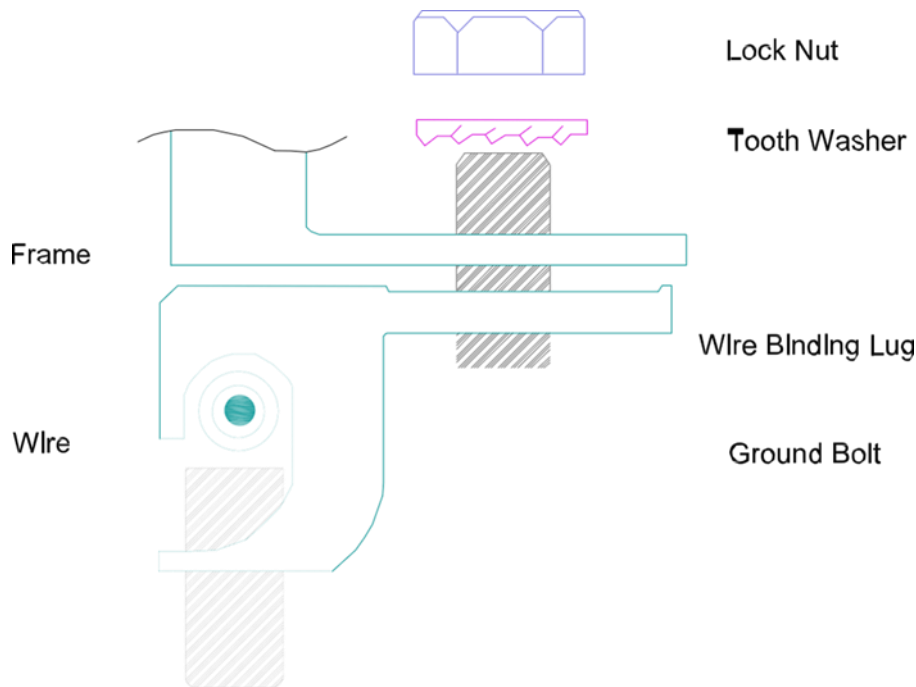


Figure 8: Installation Methods

7.3 Additional Third-Party Grounding Devices

Additionally, third party grounding devices can be used for grounding of TommaTech solar panels but such grounding shall be proved to be reliable. Grounding devices shall be operated in line with stipulations of the manufacturer.

8. OPERATIONS AND MAINTENANCE

It is necessary to perform regular inspection and maintenance of the solar panels, especially within warranty scope. It is the user's responsibility to report to the supplier regarding the damages found within 2 weeks.

8.1 Cleaning

The dust accumulated on the module may reduce the power output and even cause regional hot-spot effect. The industrial effluents or bird drops may be serious, and the extent of the severity depends on the transparency of the foreign objects. Usually, the accumulated dust does not reduce the sunshine, because the light intensity is still homogeneous. Thus, the power reduction is usually not obvious.

Under operation, there should not be any environmental affects casting shadows or covering part of or even complete solar panels, such as support structure, other solar panels, bird drops, dust, clay, plants, etc. which may distinctly reduce the power output. TommaTech suggests that there should not be any obstructed objects over the solar panels surface at any time.

The frequency of cleaning depends on dirt accumulation speed. In normal situations, rainwater will clean the module surface and reduce the cleaning frequency. It is suggested to use damp clean water sponge or soft cloth to wipe the glass surface. In any case, do not use acid and alkaline detergents to clean the solar panels.

In order to avoid potential risk of electrical shock or burn, TommaTech suggests cleaning the solar panels during early morning or in the evening with less solar irradiation and lower surface temperature. In order to avoid potential risk of electrical shock, do not try to clean the solar panels with glass damages or exposed wires.

8.2 Visual Inspection of Solar panels

Inspect the Modules visually to find whether there are appearance defects, the following need particularly special attention:

- A) Whether the glass is broken,
- B) Corrosion along the cells' busbar. The corrosion is caused by the damp infiltrated into the solar panels if the surface encapsulation materials are damaged during the installation or transportation.
- C) Whether there are burning vestiges on the backsheet.
- D) Check PV solar panels for signs of aging including rodent damage, weather damage, connection tightness, corrosion, and grounding condition.
- E) Check for any sharp objects in contact with PV solar panels' surface
- F) Check for any obstacles shielding the PV solar panels
- G) Check for any loose or damaged screws between the solar panels and brackets. If so, adjust or fix them on time.

8.3 Inspection of Connectors and Cables

It is suggested to carry out the following preventive inspection once every 6 months:

- A) Check connector sealings and cable connections.
- B) Look for gaps on the sealant of the terminal box and confirm whether it is cracking

9. APPLICABLE PRODUCTS

This installation manual is prepared for solar panels as listed below:

GROUP	MODULE TYPE	CELL TYPE	POWER RANGE (IN 5W INTERVALS)	NUMBER OF CELLS	PANEL DIMENSIONS [mm]	MOUNTING DISTANCE (mm) [L2-L1]
GROUP 1	TT60P	POLY	265W-285W	60 PCS FULL CELL	1648*995*35	280-380 mm
GROUP 2	TT72P	POLY	320W-340W	72 PCS FULL CELL	1959*995*40	330-430 mm
GROUP 3	TT60PM	PERC MONO	310W-335W	60 PCS FULL CELL	1668*1007*35	280-380 mm
GROUP 4	TT72PM	PERC MONO	375W-400W	72 PCS FULL CELL	1984*1007*40	330-430 mm
GROUP 5	TT120PM	PERC MONO MULTI BUSBAR	360W-380W	120 PCS HALF-CUT CELL	1756*1039*35	300-400 mm
GROUP 6	TT144PM	PERC MONO MULTI BUSBAR	435W-455W	144 PCS HALF-CUT CELL	2095*1039*40	350-450 mm
GROUP 7	TT108PM10	PERC MONO MULTI BUSBAR	395W-410W	108 PCS HALF-CUT CELL	1722*1134*35	280-380 mm
GROUP 8	TT108PMB10	PERC MONO BIFACIAL	395W-410W	108 PCS HALF-CUT CELL	1722*1134*35	280-380 mm
GROUP 9	TT144PM10	PERC MONO MULTI BUSBAR	530W-550W	144 PCS HALF-CUT CELL	2279*1134*35	390-490 mm
GROUP 10	TT144PMB10	PERC MONO BIFACIAL	530W-550W	144 PCS HALF-CUT CELL	2279*1134*35	390-490 mm
GROUP 11	TT156PM10	PERC MONO MULTI BUSBAR	575W-595W	156 PCS HALF-CUT CELL	2438*1135*35	420-520 mm
GROUP 12	TT156PMB10	PERC MONO BIFACIAL	575W-595W	156 PCS HALF-CUT CELL	2438*1135*35	420-520 mm
GROUP 13	TT108PM12	PERC MONO MULTI BUSBAR	530W-550W	108 PCS HALF-CUT CELL	1965*1303*35	350-450 mm
GROUP 14	TT108PMB12	PERC MONO BIFACIAL	530W-550W	108 PCS HALF-CUT CELL	1965*1303*35	350-450 mm

GROUP 15	TT120PM12	PERC MONO MULTI BUSBAR	590W-610W	120 PCS HALF-CUT CELL	2172*1303*35	350-450 mm
GROUP 16	TT120PMB12	PERC MONO BIFACIAL	590W-610W	120 PCS HALF-CUT CELL	2172*1303*35	350-450 mm
GROUP 17	TT132PM12	PERC MONO MULTI BUSBAR	650W-675W	132 PCS HALF-CUT CELL	2384*1303*35	410-510 mm
GROUP 18	TT132PMB12	PERC MONO BIFACIAL	650W-675W	132 PCS HALF-CUT CELL	2384*1303*35	410-510 mm
GROUP 19	TT108TN10	TOPCON N-TYPE	415W-435W	108 PCS HALF-CUT CELL	1722*1134*30	280-380 mm
GROUP 20	TT108TNB10	TOPCON N-TYPE BIFACIAL	415W-435W	108 PCS HALF-CUT CELL	1722*1134*30	280-380 mm
GROUP 21	TT120TN10	TOPCON N-TYPE	460W-480W	120 PCS HALF-CUT CELL	1909*1134*35	300-400 mm
GROUP 22	TT144TN10	TOPCON N-TYPE	560W-580W	144 PCS HALF-CUT CELL	2278*1134*35	390-490 mm
GROUP 23	TT144TNB10	TOPCON N-TYPE BIFACIAL	560W-580W	144 PCS HALF-CUT CELL	2278*1134*35	390-490 mm
GROUP 24	TT108TN12	TOPCON N-TYPE	555W-575W	108 PCS HALF-CUT CELL	1965*1303*35	350-450 mm
GROUP 25	TT108TNB12	TOPCON N-TYPE BIFACIAL	555W-575W	108 PCS HALF-CUT CELL	1965*1303*35	350-450 mm
GROUP 26	TT120TN12	TOPCON N-TYPE	615W-645W	120 PCS HALF-CUT CELL	2172*1303*35	350-450 mm
GROUP 27	TT120TNB12	TOPCON N-TYPE BIFACIAL	615W-645W	120 PCS HALF-CUT CELL	2172*1303*35	350-450 mm
GROUP 28	TT132TN12	TOPCON N-TYPE	680W-715W	132 PCS HALF-CUT CELL	2384*1303*35	410-510 mm
GROUP 29	TT132TNB12	TOPCON N-TYPE BIFACIAL	680W-715W	132 PCS HALF-CUT CELL	2384*1303*35	410-510 mm

GROUP 1

TT60P					
Peak Power (Pmax)	265Wp	270 Wp	275 Wp	280 Wp	285 Wp
Maximum Power Voltage (Vmp)	31,44V (30,49-32,38)	31,81V (30,85-32,76)	32,11V (31,15-33,07)	32,44V (31,47-33,41)	32,69V (31,71-33,67)
Maximum Power Current (Imp)	8,44A (8,19-8,69)	8,5A (8,24-8,75)	8,57A (8,31-8,83)	8,64A (8,38-8,9)	8,72A (8,46-8,98)
Open Circuit Voltage (Voc)	38,64V (37,48-39,8)	38,84V (37,67-40)	39,2V (38,02-40,38)	39,5V (38,31-40,68)	39,74V (38,55-40,93)
Short Circuit Current (Isc)	9,04A (8,77-9,31)	9,1V (8,83-9,37)	9,17A (8,89-9,44)	9,22A (8,94-9,5)	9,3A (9,02-9,58)

GROUP 2

TT72P					
Peak Power (Pmax)	320Wp	325 Wp	330 Wp	335 Wp	340 Wp
Maximum Power Voltage (Vmp)	37,82V (36,38-38,95)	38,11V (36,97-39,25)	38,45V (37,3-39,6)	38,83V (37,66-40)	39,18V (38-40,35)
Maximum Power Current (Imp)	8,47A (8,21-8,68)	8,53A (8,27-8,78)	8,59A (8,33-8,85)	8,63A (8,37-8,89)	8,68A (8,42-8,94)
Open Circuit Voltage (Voc)	46,5V (45,1-47,89)	46,75V (44,85-48,15)	47,01V (45,6-48,42)	47,26V (45,84-48,68)	47,63V (46,2-49,06)
Short Circuit Current (Isc)	9,06A (8,79-9,33)	9,12A (8,85-9,39)	9,17A (8,89-9,44)	9,21A (8,93-9,49)	9,24A (8,96-9,52)

GROUP 3

TT60PM						
Peak Power (Pmax)	310 Wp	315 Wp	320 Wp	325 Wp	330 Wp	335 Wp
Maximum Power Voltage (Vmp)	33,04V (32,05-34,03)	33,55V (32,54-34,56)	33,65V (32,64-34,66)	33,92V (32,9-34,94)	34,11V (33,09-35,13)	34,4V (33,37-35,43)
Maximum Power Current (Imp)	9,4A	9,41A	9,52A	9,58A	9,68A	9,75A

Open Circuit Voltage (Voc)	40,15V	40,73V	40,84V	41,14V	41,34V	41,56V
Short Circuit Current (Isc)	10,03A	10,05A	10,16A	10,23A	10,33A	10,38A

GROUP 4

TT72PM						
Peak Power (Pmax)	375 Wp	380 Wp	385 Wp	390 Wp	395 Wp	400 Wp
Maximum Power Voltage (Vmp)	40,14V	40,52V	40,7V	40,88V	41,07V	41,1V
Maximum Power Current (Imp)	9,35A	9,39A	9,47A	9,55A	9,62A	9,75A
Open Circuit Voltage (Voc)	48,67V	48,91V	49,12V	49,32V	49,54V	49,83V
Short Circuit Current (Isc)	9,94A	9,97A	10,05A	10,13A	10,24A	10,38A

GROUP 5

TT120PM-HC-MULTIBUSBAR					
Peak Power (Pmax)	360 Wp	365 Wp	370 Wp	375 Wp	380 Wp
Maximum Power Voltage (Vmp)	33,9V	34,1V	34,3V	34,5V	34,7V
Maximum Power Current (Imp)	10,62A	10,71A	10,79A	10,87A	10,94A
Open Circuit Voltage (Voc)	40,5V	40,7V	40,9V	41,1V	41,3V
Short Circuit Current (Isc)	11,35A	11,42A	11,49A	11,57A	11,64A

GROUP 6

TT144PM-HC- MULTIBUSBAR					
Peak Power (Pmax)	435 Wp	440 Wp	445 Wp	450 Wp	455 Wp
Maximum Power Voltage (Vmp)	40,8V	41,0V	41,2V	41,4V	41,6V
Maximum Power Current (Imp)	10,67A	10,74A	10,81A	10,87A	10,94A
Open Circuit Voltage (Voc)	48,6V	48,8V	49V	49,2V	49,4V
Short Circuit Current (Isc)	11,4A	11,47A	11,54A	11,61A	11,67A

GROUP 7

TT108PM10- MULTIBUSBAR				
Peak Power (Pmax)	395 Wp	400 Wp	405 Wp	410 Wp
Maximum Power Voltage (Vmp)	30,9V	31,1V	31,3V	31,5V
Maximum Power Current (Imp)	12,79A	12,86A	12,94A	13,02A
Open Circuit Voltage (Voc)	36,9V	37,1V	37,4V	37,6V
Short Circuit Current (Isc)	13,62A	13,70A	13,77A	13,85A

GROUP 8

TT108PMB10- BIFACIAL				
Peak Power (Pmax)	395 Wp	400 Wp	405 Wp	410 Wp
Maximum Power Voltage (Vmp)	30,9V	31,1V	31,3V	31,5V
Maximum Power Current (Imp)	12,79A	12,86A	12,94A	13,02A
Open Circuit Voltage (Voc)	36,9V	37,1V	37,4V	37,6V
Short Circuit Current (Isc)	13,62A	13,70A	13,77A	13,85A

GROUP 9

TT144PM10- MULTIBUSBAR					
Peak Power (Pmax)	530 Wp	535 Wp	540 Wp	545 Wp	550 Wp
Maximum Power Voltage (Vmp)	41,6V	41,8V	42,0V	42,2V	42,4V
Maximum Power Current (Imp)	12,75A	12,80A	12,86A	12,92A	12,98A
Open Circuit Voltage (Voc)	49,4V	49,6V	49,8V	50,0V	50,2V
Short Circuit Current (Isc)	13,58A	13,63A	13,70A	13,76A	13,82A

GROUP 10

TT144PMB10- BIFACIAL					
Peak Power (Pmax)	530 Wp	535 Wp	540 Wp	545 Wp	550 Wp
Maximum Power Voltage (Vmp)	41,6V	41,8V	42,0V	42,2V	42,4V
Maximum Power Current (Imp)	12,75A	12,80A	12,86A	12,92A	12,98A
Open Circuit Voltage (Voc)	49,4V	49,6V	49,8V	50,0V	50,2V
Short Circuit Current (Isc)	13,58A	13,63A	13,70A	13,76A	13,82A

GROUP 11

TT156PM10- MULTIBUSBAR					
Peak Power (Pmax)	575 Wp	580 Wp	585 Wp	590 Wp	595 Wp
Maximum Power Voltage (Vmp)	45,0V	45,2V	45,4V	45,6V	45,8V
Maximum Power Current (Imp)	12,78A	12,84A	12,89A	12,94A	12,99A
Open Circuit Voltage (Voc)	53,5V	53,7V	53,9V	54,1V	54,3V
Short Circuit Current (Isc)	13,61A	13,67A	13,73A	13,78A	13,84A

GROUP 12

TT156PMB10- BIFACIAL					
Peak Power (Pmax)	575 Wp	580 Wp	585 Wp	590 Wp	595 Wp
Maximum Power Voltage (Vmp)	45,0V	45,2V	45,4V	45,6V	45,8V
Maximum Power Current (Imp)	12,78A	12,84A	12,89A	12,94A	12,99A
Open Circuit Voltage (Voc)	53,5V	53,7V	53,9V	54,1V	54,3V
Short Circuit Current (Isc)	13,61A	13,67A	13,73A	13,78A	13,84A

GROUP 13

TT108PM12- MULTIBUSBAR					
Peak Power (Pmax)	530 Wp	535 Wp	540 Wp	545 Wp	550 Wp
Maximum Power Voltage (Vmp)	30,7V	30,9V	31,1V	31,3V	31,5V
Maximum Power Current (Imp)	17,27A	17,31A	17,36A	17,42A	17,46A
Open Circuit Voltage (Voc)	37,0V	37,2V	37,5V	37,7V	37,9V
Short Circuit Current (Isc)	18,28A	18,33A	18,38A	18,45A	18,49A

GROUP 14

TT108PMB12- BIFACIAL					
Peak Power (Pmax)	530 Wp	535 Wp	540 Wp	545 Wp	550 Wp
Maximum Power Voltage (Vmp)	30,7V	30,9V	31,1V	31,3V	31,5V
Maximum Power Current (Imp)	17,27A	17,31A	17,36A	17,42A	17,46A
Open Circuit Voltage (Voc)	37,0V	37,2V	37,5V	37,7V	37,9V
Short Circuit Current (Isc)	18,28A	18,33A	18,38A	18,45A	18,49A

GROUP 15

TT120PM12- MULTIBUSBAR					
Peak Power (Pmax)	590 Wp	595 Wp	600 Wp	605 Wp	610 Wp
Maximum Power Voltage (Vmp)	34,1V	34,2V	34,3V	34,5V	34,7V
Maximum Power Current (Imp)	17,30A	17,40A	17,50A	17,54A	17,58A
Open Circuit Voltage (Voc)	41,1V	41,3V	41,5V	41,7V	41,9V
Short Circuit Current (Isc)	18,33A	18,43A	18,53A	18,68A	18,62A

GROUP 16

TT120PMB12- BIFACIAL						
Peak Power (Pmax)	590 Wp	595 Wp	600 Wp	605 Wp	610 Wp	
Maximum Power Voltage (Vmp)	34,1V	34,2V	34,3V	34,5V	34,7V	
Maximum Power Current (Imp)	17,30A	17,40A	17,50A	17,54A	17,58A	
Open Circuit Voltage (Voc)	41,1V	41,3V	41,5V	41,7V	41,9V	
Short Circuit Current (Isc)	18,33A	18,43A	18,53A	18,68A	18,62A	

GROUP 17

TT132PM12- MULTIBUSBAR						
Peak Power (Pmax)	650 Wp	655 Wp	660 Wp	665 Wp	670 Wp	675 Wp
Maximum Power Voltage (Vmp)	37,5V	37,7V	37,9V	38,1V	38,3V	38,5V
Maximum Power Current (Imp)	17,34A	17,38A	17,42A	17,46A	17,50A	17,54A
Open Circuit Voltage (Voc)	45,2V	45,4V	45,6V	45,8V	46,0V	46,2V
Short Circuit Current (Isc)	18,35A	18,39A	18,44A	18,48A	18,51A	18,56A

GROUP 18

TT132PMB12- BIFACIAL						
Peak Power (Pmax)	650 Wp	655 Wp	660 Wp	665 Wp	670 Wp	675 Wp
Maximum Power Voltage (Vmp)	37,5V	37,7V	37,9V	38,1V	38,3V	38,5V
Maximum Power Current (Imp)	17,34A	17,38A	17,42A	17,46A	17,50A	17,54A
Open Circuit Voltage (Voc)	45,2V	45,4V	45,6V	45,8V	46,0V	46,2V
Short Circuit Current (Isc)	18,35A	18,39A	18,44A	18,48A	18,51A	18,56A

GROUP 19

TT108TN10					
Peak Power (Pmax)	415 Wp	420 Wp	425 Wp	430 Wp	435 Wp
Maximum Power Voltage (Vmp)	31,74V	31,94V	32,14V	32,34V	32,54V
Maximum Power Current (Imp)	13,08A	13,15A	13,23A	13,30A	13,37A
Open Circuit Voltage (Voc)	37,71V	37,91V	38,11V	38,31V	38,51V
Short Circuit Current (Isc)	13,88A	13,95A	14,03A	14,10A	14,17A

GROUP 20

TT108TNB10-TOPCON BIFACIAL					
Peak Power (Pmax)	415 Wp	420 Wp	425 Wp	430 Wp	435 Wp
Maximum Power Voltage (Vmp)	31,74V	31,94V	32,14V	32,34V	32,54V
Maximum Power Current (Imp)	13,08A	13,15A	13,23A	13,30A	13,37A
Open Circuit Voltage (Voc)	37,71V	37,91V	38,11V	38,31V	38,51V
Short Circuit Current (Isc)	13,88A	13,95A	14,03A	14,10A	14,17A

GROUP 21

TT120TN10-TOPCON					
Peak Power (Pmax)	460 Wp	465 Wp	470 Wp	475 Wp	480 Wp
Maximum Power Voltage (Vmp)	35,26V	35,46V	35,66 V	35,86 V	36,06 V
Maximum Power Current (Imp)	13,05A	13,12A	13,19A	13,25A	13,32A
Open Circuit Voltage (Voc)	41,90V	42,10V	42,30V	42,50V	42,70V
Short Circuit Current (Isc)	13,86A	13,93A	14,00A	14,08A	14,14A

GROUP 22

TT144TN10-TOPCON					
Peak Power (Pmax)	560 Wp	565 Wp	570 Wp	575 Wp	580 Wp
Maximum Power Voltage (Vmp)	42,15V	42,35V	42,55V	42,75V	42,95V
Maximum Power Current (Imp)	13,29A	13,34A	13,40A	13,46A	13,51A
Open Circuit Voltage (Voc)	50,18V	50,18V	50,18V	50,18V	50,18V
Short Circuit Current (Isc)	14,04A	14,11A	14,17A	14,23A	14,31A

GROUP 23

TT144TNB10- TOPCON BIFACIAL					
Peak Power (Pmax)	560 Wp	565 Wp	570 Wp	575 Wp	580 Wp
Maximum Power Voltage (Vmp)	42,15V	42,35V	42,55V	42,75V	42,95V
Maximum Power Current (Imp)	13,29A	13,34A	13,40A	13,46A	13,51A
Open Circuit Voltage (Voc)	50,18V	50,18V	50,18V	50,18V	50,18V
Short Circuit Current (Isc)	14,04A	14,11A	14,17A	14,23A	14,31A

GROUP 24

TT108TN12- TOPCON					
Peak Power (Pmax)	555 Wp	560 Wp	565 Wp	570 Wp	575 Wp
Maximum Power Voltage (Vmp)	32,40V	32,60V	32,80V	33,00V	33,20V
Maximum Power Current (Imp)	17,13A	17,18A	17,23A	17,28A	17,32A
Open Circuit Voltage (Voc)	37,60V	37,80V	38,00V	38,20V	38,40V
Short Circuit Current (Isc)	18,22A	18,27A	18,33A	18,38A	18,22A

GROUP 25

TT108TNB12- TOPCON BIFACIAL					
Peak Power (Pmax)	555 Wp	560 Wp	565 Wp	570 Wp	575 Wp
Maximum Power Voltage (Vmp)	32,40V	32,60V	32,80V	33,00V	33,20V
Maximum Power Current (Imp)	17,13A	17,18A	17,23A	17,28A	17,32A
Open Circuit Voltage (Voc)	37,60V	37,80V	38,00V	38,20V	38,40V
Short Circuit Current (Isc)	18,22A	18,27A	18,33A	18,38A	18,22A

GROUP 26

TT120TN12-TOPCON							
Peak Power (Pmax)	615 Wp	620 Wp	625 Wp	630 Wp	635 Wp	640 Wp	645 Wp
Maximum Power Voltage (Vmp)	35,56V	35,76V	35,96V	36,16V	36,36V	36,56V	36,6V
Maximum Power Current (Imp)	17,30A	17,34A	17,39A	17,43A	17,45A	17,51A	17,55A
Open Circuit Voltage (Voc)	42,78V	42,98V	43,18V	43,38V	43,58V	43,78V	43,98V
Short Circuit Current (Isc)	18,24A	18,30A	18,35A	18,40A	18,46A	18,52A	18,57A

GROUP 27

TT120TNB12-TOPCON BIFACIAL							
Peak Power (Pmax)	615 Wp	620 Wp	625 Wp	630 Wp	635 Wp	640 Wp	645 Wp
Maximum Power Voltage (Vmp)	35,56V	35,76V	35,96V	36,16V	36,36V	36,56V	36,6V
Maximum Power Current (Imp)	17,30A	17,34A	17,39A	17,43A	17,45A	17,51A	17,55A
Open Circuit Voltage (Voc)	42,78V	42,98V	43,18V	43,38V	43,58V	43,78V	43,98V

Short Circuit Current (Isc)	18,24A	18,30A	18,35A	18,40A	18,46A	18,52A	18,57A
-----------------------------	--------	--------	--------	--------	--------	--------	--------

GROUP 28

TT132TN12- TOPCON								
Peak Power (Pmax)	680 Wp	685 Wp	690 Wp	695 Wp	700 Wp	705 Wp	710 Wp	715 Wp
Maximum Power Voltage (Vmp)	39,50V	39,70V	39,90V	40,10V	40,30V	40,50V	40,70V	40,90V
Maximum Power Current (Imp)	17,22A	17,25A	17,29A	17,33A	17,37A	17,41A	17,45A	17,49A
Open Circuit Voltage (Voc)	46,10V	46,30V	46,50V	46,70V	46,90V	47,10V	47,30V	47,50V
Short Circuit Current (Isc)	18,26A	18,32A	18,37A	18,42A	18,47A	18,52A	18,57A	18,62A

GROUP 29

TT132TNB12- TOPCON BIFACIAL								
Peak Power (Pmax)	680 Wp	685 Wp	690 Wp	695 Wp	700 Wp	705 Wp	710 Wp	715 Wp
Maximum Power Voltage (Vmp)	39,50V	39,70V	39,90V	40,10V	40,30V	40,50V	40,70V	40,90V
Maximum Power Current (Imp)	17,22A	17,25A	17,29A	17,33A	17,37A	17,41A	17,45A	17,49A
Open Circuit Voltage (Voc)	46,10V	46,30V	46,50V	46,70V	46,90V	47,10V	47,30V	47,50V
Short Circuit Current (Isc)	18,26A	18,32A	18,37A	18,42A	18,47A	18,52A	18,57A	18,62A

All values measured at STC; 1000W/m², 25°C, 1.5AM